



**SKG-IKOB**

Certificatie



Member of



www.eota.eu

## SKG-IKOB

Certificatie BV

Poppenbouwing 56,  
NL-4191 NZ Geldermalsen  
Postbus 202  
NL-4190 CE Geldermalsen  
Tel: +31(0)88-244 01 00  
E-mail: info@skgikob.nl  
Website: [www.skgikob.nl](http://www.skgikob.nl)

# European Technical Assessment

**ETA-20/1119**  
**Of 15/06/2022**

### General part

**Technical Assessment Body issuing the European Technical Assessment:**  
**SKG-IKOB Certificatie BV**

**Trade name of the construction product**

**Bostik FP 403 Fireseal Hybrid**

**Product family to which the construction product belongs**

**Fire Stopping and Sealing Product:  
Linear Joint and Gap Seals**

**Manufacturer**

**Bostik Benelux BV**  
Denariusstraat 11  
4903 RC Oosterhout  
The Netherlands  
Tel.: +31(0)1624 910 00  
E-mail: [infoNL@bostik.com](mailto:infoNL@bostik.com)  
Web: [www.bostik.com](http://www.bostik.com)

**Manufacturing plants**

**P02**

**This European Technical Assessment contains**

14 pages including 2 Annex which form an integral part of this assessment.

**This European Technical Assessment is issued in accordance with regulation (EU) No 305/2011, on the basis of**

EAD 350141-00-1106, edition September 2017

**This version replaces**

ETA 20/1119, version 2, issued on 2022-02-28

Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may be made, with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.

## Specific parts

### 1 Technical description of the product

Bostik FP 403 Fireseal Hybrid is used to form a joint seal in linear joints, voids, gaps and other discontinuities within one or between two or more construction elements to reinstate the fire resistance performance of wall and floor constructions.

| Product                | Properties   |
|------------------------|--|
| FP 403 Fireseal Hybrid | FP 403 Fireseal Hybrid is a hybrid sealant. Supplied in liquid form contained within 290 ml cartridges or 600 ml sausages. The Sealant is gunned into the linear joint of adjacent separating elements, to a specified depth, if necessary utilizing PE / PU backer rod. |

### 2 Specification of the intended uses in accordance with the applicable Assessment Document (hereinafter EAD)

#### 2.1 Intended use

The intended use of Bostik FP 403 Fireseal Hybrid is to reinstate the fire resistance performance of linear joints in rigid wall constructions and in rigid floor constructions.

The specific elements of construction for the Bostik FP 403 Fireseal Hybrid to be used in, to provide a joint seal, are as follows:

- Flexible walls
- Rigid walls
- Rigid floors

The supporting construction must be classified in accordance with EN 13501-2 for the required fire resistance period. Detailed information and data is given in Annex A.

Environmental conditions are:

Type Z<sub>2</sub>: intended for uses in internal conditions with humidity lower than 85 % RH excluding temperatures below 0°C, without exposure to rain or UV.

#### 2.2 Working life

The assumed working life of Bostik FP 403 Fireseal Hybrid is for the intended use 25 years, provided that the assembled product is subject to appropriate installation, use and maintenance. The indication of 25 years cannot be interpreted as a guarantee given by Bostik Benelux BV, but should only be regarded as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

### 3. Performance of the product and references to the methods used for its assessment

The assessment of fitness for use has been made in accordance with EAD 350141-00-1106.

| Bostik FP 403 Fireseal Hybrid                  |  |                             |
|--|--|-----------------------------|
| No   | Essential Characteristic                                 | Product performances        |
| <b>BWR 2 Safety in case of fire</b>            |  |                             |
| 1  | Reaction to fire   | B-s1,d0                     |
| 2  | Resistance to fire                                       | See annex A                 |
| <b>BWR 3 Hygiene, health and environment</b>   |  |                             |
| 3  | Content, emission and/or release of dangerous substances | Declaration of manufacturer |
| 4  | Air permeability (material property)                     | No performance assessed     |
| 5  | Water permeability (material property)                   | No performance assessed     |
| <b>BWR 4 Safety and accessibility in use</b>   |  |                             |
| 6  | Mechanical resistance and stability                      | No performance assessed     |
| 7  | Resistance to impact/movement                            | No performance assessed     |
| 8  | Adhesion   | passed                      |
| 9  | Durability   | Z <sub>2</sub>              |
| 10   | Movement capability                                      | See annex A                 |
| 11   | Cycling of perimeter seals for curtain walls             | Not relevant                |
| 12   | Compression set  | Not relevant                |
| 13   | Linear expansion on setting                              | Not relevant                |
| <b>BWR 5 Protection against noise</b>          |  |                             |
| 14   | Airborne sound insulation                                | See annex B                 |
| <b>BWR 6 Energy economy and heat retention</b> |  |                             |
| 15   | Thermal properties                                       | No performance assessed     |
| 16   | Water vapour permeability                                | No performance assessed     |

### 4 Assessment and verification of consistency of performance (hereinafter AVCP) system applied, with reference to its legal base

According to the decision 1999/454/EC – Commission Decision of date 22nd June 1999 on the procedure for attesting the conformity of construction products pursuant to Article 20(2) of Council Directive 89/106/EEC as regards fire stopping, fire sealing and fire protective products, published in the Official Journal of the European Union (OJEU) L178/52 of 14/07/1999, see <http://eur-lex.europa.eu/JOLIndex.do> of the European Commission1, as amended, the system(s) of assessment and verification of constancy of performance (see Annex V to Regulation (EU) No 305/2011) given in the following table(s) applies (apply).

| Product(s)                              | Intended use(s)  | Level(s) or class(es) | System(s) |
|---|--|-----------------------|-----------|
| Fire stopping and fire sealing products | For fire compartmentation and/or fire protection or fire performance | Any                   | 1         |

## 5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD

### Tasks of the manufacturer

#### *Factory production control*

The manufacturer shall exercise permanent internal control of production. All the elements, requirements and provisions adopted by the manufacturer shall be documented in a systematic manner in the form of written policies and procedures, including records of results performed. This production control system shall ensure that the product is in conformity with this European technical Assessment. The manufacturer may only use initial / raw / constituent materials stated in the technical documentation of this European Technical Assessment.

The factory production control shall be in accordance with the Control Plan of 07/12/2021 relating to the European technical assessment ETA 20/1119 issued on 15/06/2022 which is part of the technical documentation of this European technical approval. The "Control Plan" is laid down in the context of the factory production control system operated by the manufacturer and deposited at SKG-IKOB.

The results of factory production control shall be recorded and evaluated in accordance with the provisions of the Control Plan.

### Other tasks of the manufacturer

#### *Additional information*

The manufacturer shall provide a technical data sheet and an installation instruction with the following minimum information:

(a) Technical data sheet:

- Field of application:
- Building elements for which the linear joint seal is suitable, type and properties of the building elements like minimum thickness, density, and - in case of lightweight constructions – the construction requirements.
- Limits in size, minimum thickness etc. of the linear joint seal
- Construction of the linear joint seal including the necessary components and additional products (e.g. backfilling material) with clear indication whether they are generic or specific.


(b) Installation instruction:

- Steps to be followed
- Procedure in case of retrofitting
- Stipulations on maintenance, repair and replacement

Issued in Geldermalsen, the Netherlands on 15/06/2022

The original English version is signed on behalf of SKG-IKOB

by



ir. H.A.J. van Dartel  
Certification Manager


## Annex A – Resistance to fire

| <b>Fire resistance classification<br/>(vertical linear joint seals in a stone wall)</b> |
|---|
| <b>Connecting stone to stone<br/>wall <math>\geq 70</math> mm</b>                       |
| <b>Bostik FP 403 unexposed face</b>   |
| EI 60 – V – X – F – W 5 to 10   |
| EI 45 – V – X – F – W 10 to 20  |
| E 240 – V – X – F – W 5 to 20   |

E = Criterion integrity, I = Criterion insulation, V = Vertical application in a vertical wall, X = No movement applied, F = Splice applied in the field, W = Permitted width range in millimetres (see Graph 1 for seal depth)

The following conditions apply:

- the classifications are valid for linear joint seals in a wall with an orientation as mentioned (vertical);
- the linear joint seals may connect to any type of wall of aerated concrete (class G4/600 or heavier), concrete, block work, limestone or masonry with a minimal thickness of 70 mm;
- the surfaces of the material on which FP 403 Fireseal Hybrid is applied are thoroughly cleaned and treated with primer and moistened with water when needed;
- the use of suitable PE / PU backing material is mandatory;
- the depth of FP 403 Fireseal Hybrid depends on the width of the linear joint seal. The minimum depth of FP 403 Fireseal Hybrid in relation to the width of the linear joint seal is shown in Graph 1 below. The depth of the sealant may also be increased with respect to the Graph (the lines are the minimum and recommended seal depth);
- the allowed movement capability in practice is maximized to 7.5 %;
- when FP 403 Fireseal Hybrid is applied at one face, the classifications are valid with FP 403 Fireseal Hybrid at the unexposed face.

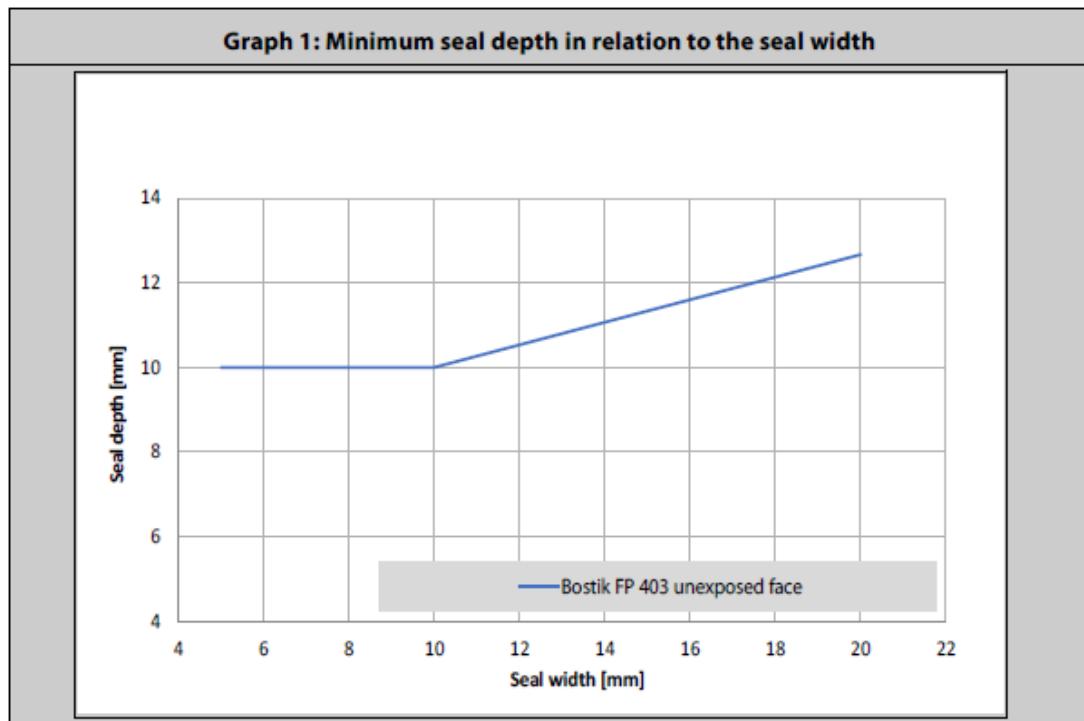


| <b>Fire resistance classification</b><br><b>(vertical linear joint seals in a stone wall)</b>   |   |  |  |
|---|---|--|--|
| <b>Connecting stone to stone</b><br><b>wall <math>\geq 100</math> mm</b>  |   |  |  |
| <b>Bostik FP 403 exposed face, Bostik FP 404 unexposed face</b><br><br>EI 45 – V – X – F – W 8 to 40<br>E 120 – V – X – F – W 8 to 40 | <b>Bostik FP 403 applied at exposed face</b><br><br>EI 60 – V – X – F – W 5 to 40<br>E 120 – V – X – F – W 5 to 40<br>EI 120 – T – X – F – W 5 to 50<br>E 180 – T – X – F – W 5 to 50 | <b>Bostik FP 403 applied at unexposed face</b><br><br>EI 60 – V – X – F – W 5 to 40<br>E 240 – V – X – F – W 5 to 40<br>EI 90 – T – X – F – W 5 to 50<br>E 240 – T – X – F – W 5 to 50 | <b>Bostik FP 403 applied at both faces</b><br><br>EI 240 – V – X – F – W 5 to 50<br>EI 180 – V – X – F – W 50 to 60<br>E 240 – V – X – F – W 5 to 60 |

E = Criterion Integrity, I = Criterion insulation, V = Vertical application in a vertical wall, T = Horizontal application in a vertical wall,  
 X = No movement applied, F = Splice applied in the field, W = Permitted width range in millimetres (see Graph 2 for seal depth)

The following conditions apply:

- the classifications are valid for linear joint seals in a wall with an orientation as mentioned (vertical or horizontal);
- the linear joint seals may connect to any type of wall of aerated concrete (class G4/600 or heavier), concrete, block work, limestone or masonry with a minimal thickness of 100 mm;
- the surfaces of the material on which FP 403 Fireseal Hybrid or FP 404 Fire Retardant PU (Gun)Foam is applied are thoroughly cleaned and treated with primer and moistened with water when needed;
- except for the linear joint seal in combination with FP 404 Fire Retardant PU (Gun)Foam, the use of suitable PE / PU backing material is mandatory;
- the depth of FP 403 Fireseal Hybrid depends on the width of the linear joint seal. The minimum depth of FP 403 Fireseal Hybrid in relation to the width of the linear joint seal is shown in Graph 2 below. The depth of the sealant may also be increased with respect to the Graph (the lines are the minimum and recommended seal depth). Where the rest of the slot is fully filled with FP 404 Fire Retardant PU (Gun)Foam the seal depth of the FP 403 Fireseal Hybrid is minimal 3 mm;
- the allowed movement capability in practice is maximized to 7.5 %;
- when FP 403 Fireseal Hybrid is applied at both faces, the classifications are valid for both directions.

When FP 403 Fireseal Hybrid is applied at one face, the classifications are valid with FP 403 Fireseal Hybrid at the unexposed face or at the exposed face.

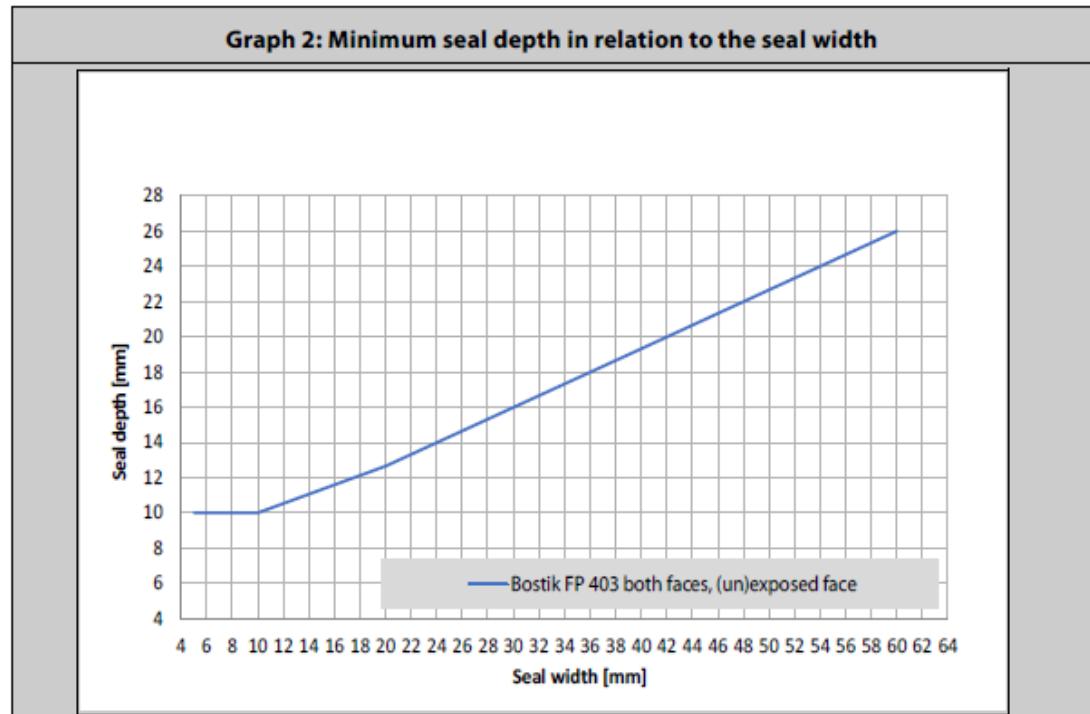


| <b>Fire resistance classification<br/>(vertical linear joint seals in a stone wall)</b> |  |  |
|---|--|--|
| <b>Connecting stone to stone<br/>wall <math>\geq 115</math> mm</b>                      |  |  |
| <b>Bostik FP 403 unexposed face,<br/>Bostik FP 404 exposed face</b>                     | <b>Bostik FP 403 applied at unexposed<br/>face</b> | <b>Bostik FP 403 applied at both faces</b> |
| EI 180 – V – X – F – W 8 to 25  | EI 60 – V – X – F – W 5 to 20                      | EI 240 – V – X – F – W 5 to 30             |
| EI 240 – V – X – F – W 8  | EI 180 – V – X – F – W 5                           | E 240 – V – X – F – W 5 to 30              |
| E 240 – V – X – F – W 8 to 25   | E 240 – V – X – F – W 5 to 20                      |  |

E = Criterion Integrity, I = Criterion insulation, V = Vertical application in a vertical wall, X = No movement applied, F = Splice applied in the field, W = Permitted width range in millimetres (see Graph 3 for seal depth)

The following conditions apply:

- the classifications are valid for linear joint seals in a wall with an orientation as mentioned (vertical);
- the linear joint seals may connect to any type of wall of aerated concrete (class G4/600 or heavier), concrete, block work, limestone or masonry with a minimal thickness of 115 mm;
- the surfaces of the material on which FP 403 Fireseal Hybrid or FP 404 Fire Retardant PU (Gun)Foam is applied are thoroughly cleaned and treated with primer and moistened with water when needed;
- except for the linear joint seal in combination with FP 404 Fire Retardant PU (Gun)Foam, the use of suitable PE / PU backing material is mandatory;
- the depth of FP 403 Fireseal Hybrid depends on the width of the linear joint seal. The minimum depth of FP 403 Fireseal Hybrid in relation to the width of the linear joint seal is shown in Graph 3 below. The depth of the sealant may also be increased with respect to the Graph (the lines are the minimum and recommended seal depth). When applicable, the rest of the slot is fully filled with FP 404 Fire Retardant PU (Gun)Foam;
- the allowed movement capability in practice is maximized to 7.5 %;
- when FP 403 Fireseal Hybrid is applied at both faces, the classifications are valid for both directions. When FP 403 Fireseal Hybrid is applied at one face, the classifications are valid with FP 403 Fireseal Hybrid at the unexposed face.

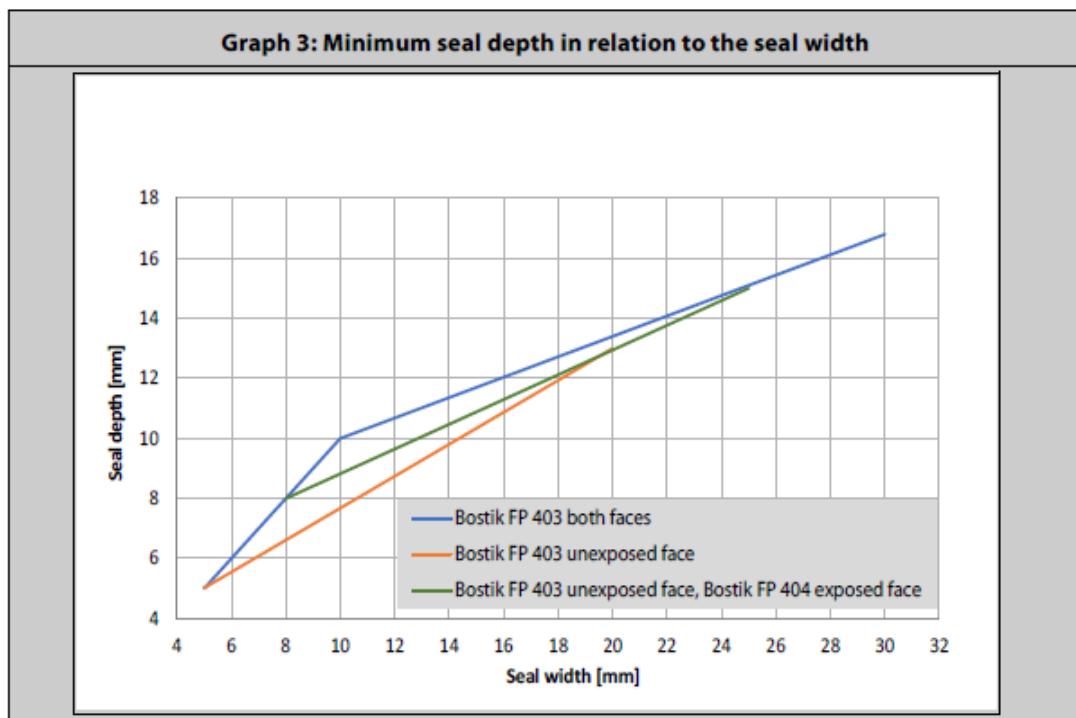


| <b>Fire resistance classification</b><br><b>(vertical linear joint seals in a stone wall)</b>        |  |  |   |
|--|--|--|---|
| <b>Connecting stone to stone</b><br><b>wall <math>\geq 150</math> mm</b>                             |  | <b>Connecting stone to</b><br><b>stone</b><br><b>wall <math>\geq 200</math> mm</b>                                   |   |
| <b>Bostik FP 403 exposed face, Bostik FP 404 unexposed face</b><br><br>EI 60 – V – X – F – W 8 to 50 | <b>Bostik FP 403 applied at exposed face</b><br><br>EI 45 – T – X – F – W 5 to 50<br>E 240 – T – X – F – W 5 to 50 | <b>Bostik FP 403 applied at unexposed face</b><br><br>EI 90 – T – X – F – W 5 to 50<br>E 240 – T – X – F – W 5 to 50 | <b>Bostik FP 403 exposed face, Bostik FP 404 unexposed face</b><br><br>EI 120 – V – X – F – W 8 to 50 |

E = Criterion integrity, I = Criterion insulation, V = Vertical application in a vertical wall, T = Horizontal application in a vertical wall, X = No movement applied, F = Splice applied in the field, W = Permitted width range in millimetres (see Graph 4 for seal depth)

The following conditions apply:

- the classifications are valid for linear joint seals in a wall with an orientation as mentioned (vertical or horizontal);
- the linear joint seals may connect to any type of wall of aerated concrete (class G4/600 or heavier), concrete, block work, limestone or masonry with a minimal thickness of 150 mm or 200 mm;
- the surfaces of the material on which FP 403 Fireseal Hybrid or FP 404 Fire Retardant PU (Gun)Foam is applied are thoroughly cleaned and treated with primer and moistened with water when needed;
- except for the linear joint seal in combination with FP 404 Fire Retardant PU (Gun)Foam, the use of suitable PE / PU backing material is mandatory;
- the depth of FP 403 Fireseal Hybrid depends on the width of the linear joint seal. The minimum depth of FP 403 Fireseal Hybrid in relation to the width of the linear joint seal is shown in Graph 4 below. The depth of the sealant may also be increased with respect to the Graph (the lines are the minimum and recommended seal depth). Where the rest of the slot is fully filled with FP 404 Fire Retardant PU (Gun)Foam the seal depth of the FP 403 Fireseal Hybrid is minimal 3 mm;
- the allowed movement capability in practice is maximized to 7.5 %;
- when FP 403 Fireseal Hybrid is applied at both faces, the classifications are valid for both directions. When FP 403 Fireseal Hybrid is applied at one face, the classifications are valid with FP 403 Fireseal Hybrid at the unexposed face or exposed face.

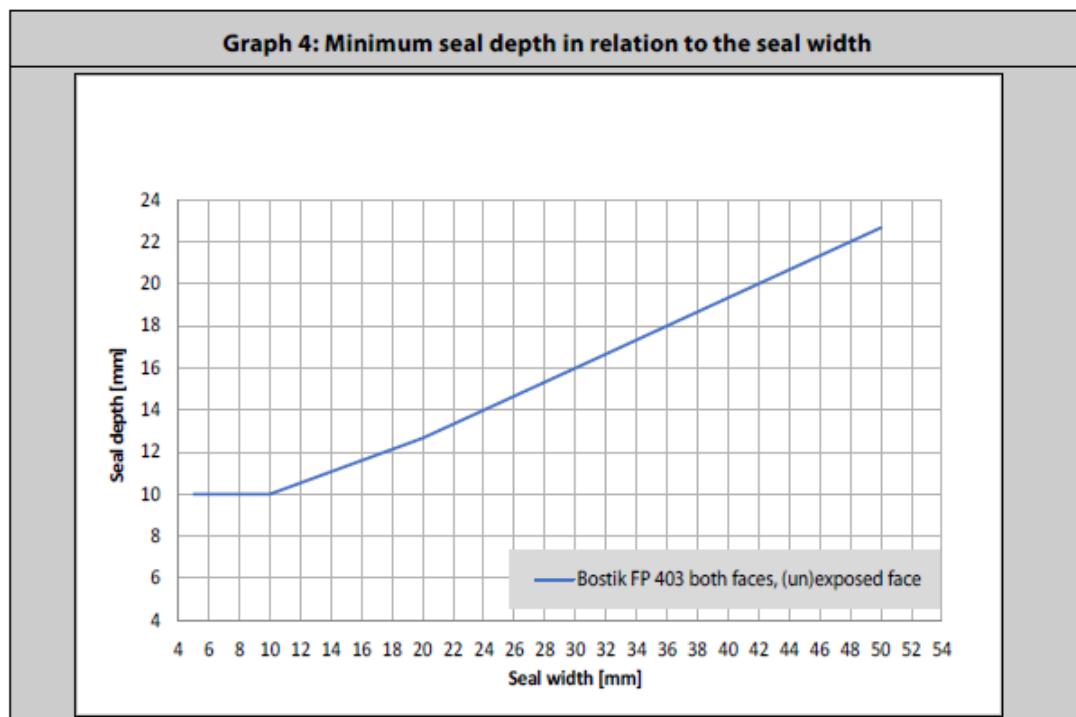


| <b>Fire resistance classification</b><br><b>(horizontal linear joint seals in a stone wall and a wall abutting a floor)</b>          |  |
|--|--|
| <b>Bostik FP 403 connecting stone to stone, applied at both faces</b><br><b>Wall / floor with thickness <math>\geq 100</math> mm</b> |  |
| <b>EI 240 – T – M 25 – F – W 10 to 30</b><br><b>EI 180 – T – M 25 – F – W 30 to 40</b><br><b>E 240 – T – M 25 – F – W 10 to 40</b>   |  |

E = Criterion Integrity, I = Criterion insulation, T = Horizontal application in a vertical wall and a wall abutting a floor, M = Movement induced in %, F = Splice applied in the field, W = Permitted width range in millimetres (see Graph 5 for seal depth)

The following conditions apply:

- the classifications are valid for linear joint seals in a wall and a wall abutting a floor, ceiling or roof with an orientation as mentioned (horizontal);
- the linear joint seals may connect to any type of construction of aerated concrete (class G4/600 or heavier), concrete, block work or masonry with a minimal thickness as mentioned (100 mm);
- the surfaces of the material on which FP 403 Fireseal Hybrid is applied are thoroughly cleaned and treated with Primer when needed;
- the use of suitable PE / PU backing material is mandatory;
- the required depth of FP 403 Fireseal Hybrid depends on the width of the linear joint seal. The minimum depth of FP 403 Fireseal Hybrid in relation to the width of the linear joint seal is shown in Graph 5 below. The required depth of the sealant may also be increased with respect to the Graph (the line gives the minimum and recommended seal depth);
- deformation of the linear joint seals in practice is maximized to 25 %;
- the classifications are valid for both directions.

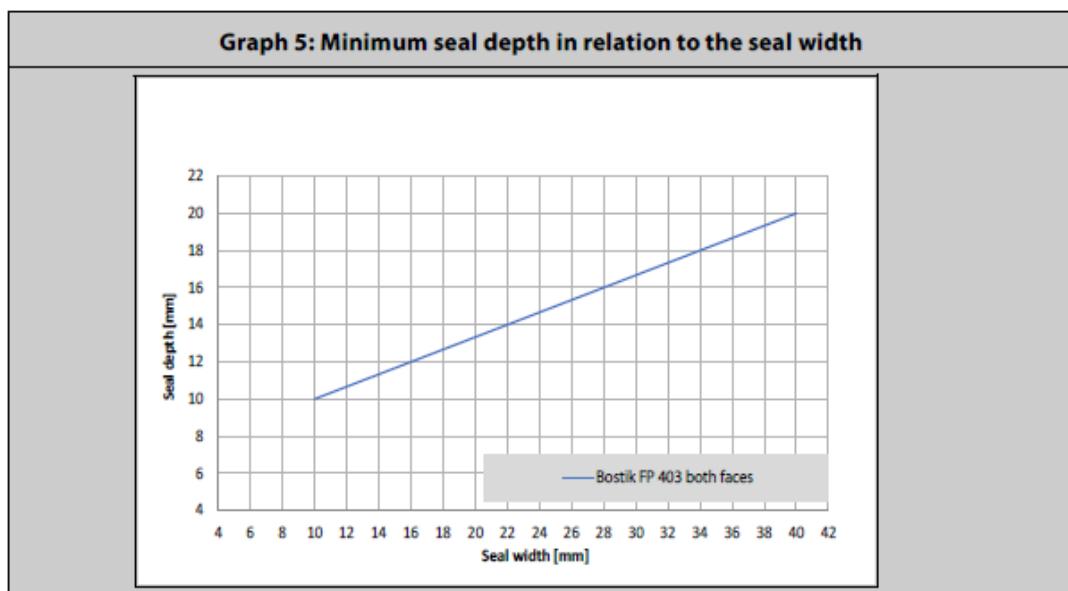

| <b>Fire resistance classification</b><br><b>(linear joint seals in a floor with thickness <math>\geq 100</math> mm)</b> |                                  |
|---|----------------------------------|
| <b>Applied at exposed side</b>  | <b>Applied at unexposed side</b> |
| EI 90 – H – X – F – W 10  | EI 120 – H – X – F – W 10        |
| EI 30 – H – X – F – W 10 to 40  | EI 60 – H – X – F – W 10 to 40   |
| E 120 – H – X – F – W 10 to 40  | E 120 – H – X – F – W 10 to 25   |
|   | E 60 – H – X – F – W 40          |


E = Criterion integrity, I = Criterion insulation, H = Horizontal supporting construction (floor), X = No movement applied  
 F = Splice applied in the field, W = Permitted width range in millimetres (see Graph 3 for seal depth)

| <b>Fire resistance classification</b><br><b>(linear joint seals in a wall abutting a floor with thickness both <math>\geq 100</math> mm)</b> |                                  |
|--|----------------------------------|
| <b>Applied at exposed side</b>   | <b>Applied at unexposed side</b> |
| EI 90 – T – X – F – W 10   | EI 120 – T – X – F – W 10        |
| EI 30 – T – X – F – W 10 to 40   | EI 60 – T – X – F – W 10 to 40   |
| E 120 – T – X – F – W 10 to 40   | E 120 – T – X – F – W 10 to 25   |
|  | E 60 – T – X – F – W 40          |

E = Criterion integrity, I = Criterion insulation, T = Horizontal application in a wall abutting a floor, X = No movement applied,  
 F = Splice applied in the field, W = Permitted width range in millimetres (see Graph 6 for seal depth)

The following conditions apply:

- the linear joint seals may be applied at any type of floor and / or wall of aerated concrete (class G4/600 or heavier), concrete, block work, limestone or masonry with a minimal thickness as mentioned above. In a floor application, the fire resistance applies from below. The fire resistance in a wall abutting a floor application is valid from one side;
- the classifications are not valid for horizontally orientated joints in a wall;
- the surfaces of the material on which the FP 403 Fireseal Hybrid is applied are thoroughly cleaned and treated with Primer when needed;
- the use of suitable PE / PU backing material is mandatory;
- the required depth of the FP 403 Fireseal Hybrid depends on the width of the linear joint seal. The minimal depth of the sealant in relation to the width of the linear joint seal is shown in Graph 6 below. The required depth of the sealant may also be increased with respect to the Graph (the line gives the minimum and recommended seal depth);
- the allowed movement capability in practice is maximized to 7.5%.

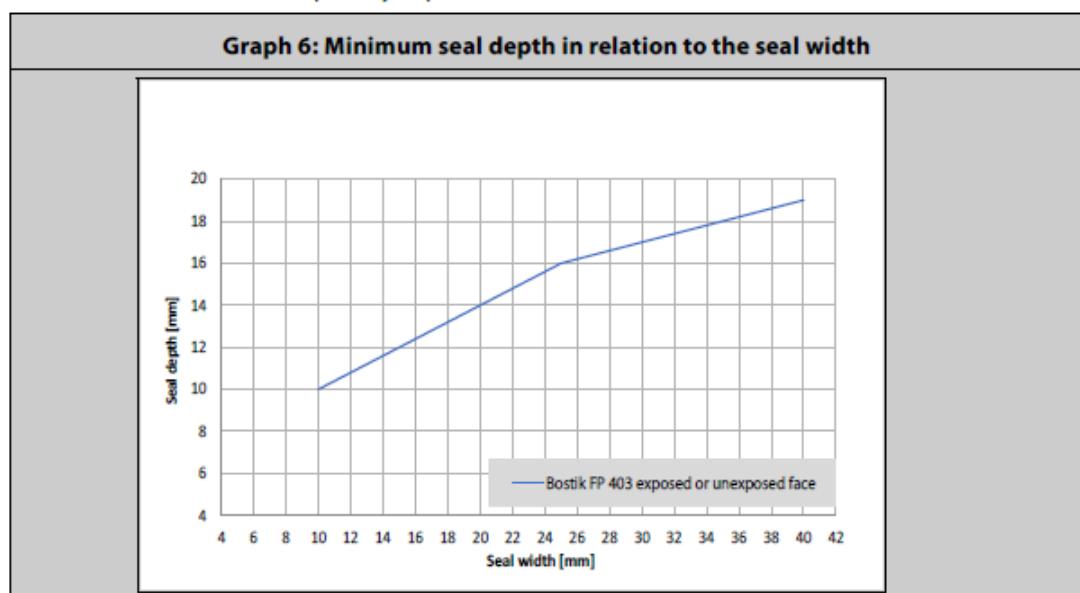


| Fire resistance classification  |  |
|---|--|
| <b>Applied at both faces</b>  |  |
| <b>Wall abutting a floor</b>  |  |
| <b>Wall thickness <math>\geq 100</math> mm / Floor thickness <math>\geq 150</math> mm</b> |  |
| EI 240 – T – X – F – W 5 to 50  |  |
| <b>Applied at exposed face</b>  |  |
| <b>Wall abutting a floor</b>  |  |
| <b>Wall thickness <math>\geq 100</math> mm / Floor thickness <math>\geq 150</math> mm</b> |  |
| EI 30 – T – X – F – W 5 to 50   |  |
| E 180 – T – X – F – W 5 to 50   |  |

E = Criterion Integrity, I = Criterion insulation, T = Horizontal application in a vertical wall (abutting a floor),  
 X = No movement applied, F = Splice applied in the field, W = Permitted width range in millimetres (depth see conditions)

The following conditions apply:

- the classifications are valid for a horizontal orientation in a vertical wall or for a horizontal orientation in a vertical wall abutting a horizontal floor;
- the linear joint seals may be applied at both sides or one side to any type of wall of aerated concrete (class G4/600 or heavier), concrete, block work, limestone or masonry with a minimal thickness of 100 mm for the wall and a minimal thickness of 150 mm for the floor;
- the surfaces of the material on which the sealant is applied are thoroughly cleaned and treated with Primer when needed;
- the use of suitable PE / PU backing material is mandatory;
- the required depth of the FP 403 Fireseal Hybrid depends on the width of the linear joint seal. The minimal depth of the sealant in relation to the width of the linear joint seal is shown in Graph 7. The required depth of the sealant may also be increased with respect to the Graph (the line gives the minimum and recommended seal depth);
- the linear joint seals are tested without mechanically induced movement, therefore the allowed movement capability in practice is maximized to 7.5 %;
- the classifications are valid for the tested directions.

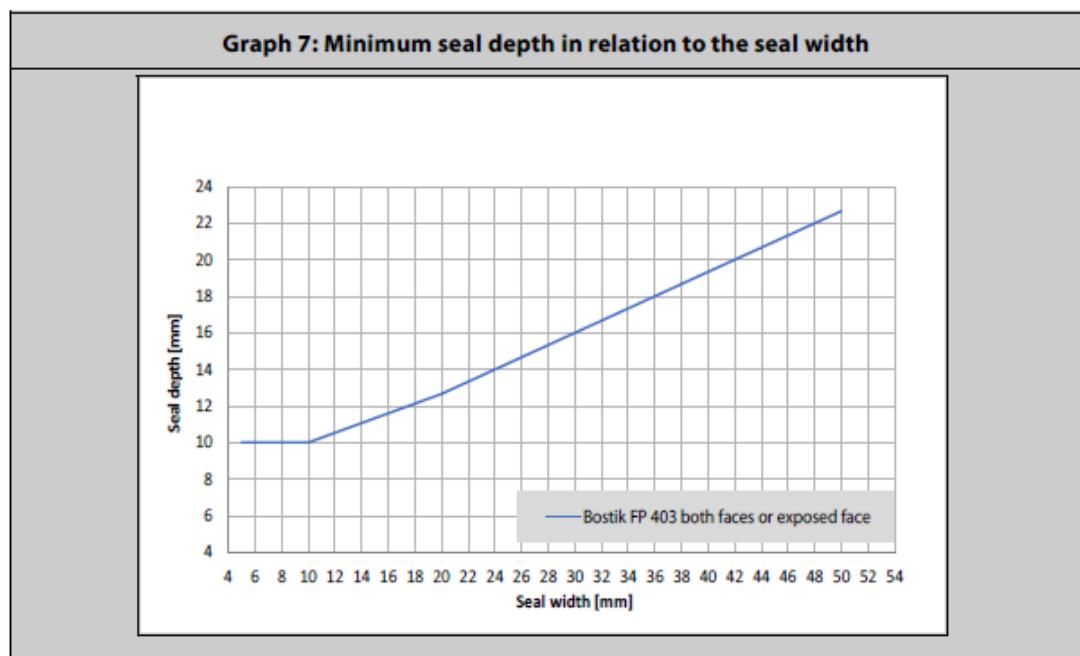

| <b>Fire resistance classification</b><br><b>(vertical linear joint seals in a stone wall)</b> |   |                                |
|---|---|--------------------------------|
| <b>Bostik FP 403 applied at both faces, connecting stone to wood</b>                          | <b>Bostik FP 403 applied at both faces, connecting stone to steel</b> |                                |
| <b>Wall thickness ≥ 100 mm</b>  | <b>Wall thickness ≥ 100 mm</b>  | <b>Wall thickness ≥ 150 mm</b> |
| EI 120 – V – X – F – W 5 to 20  | EI 30 – V – X – F – W 5 to 20   | EI 60 – V – X – F – W 5 to 20  |
| E 120 – V – X – F – W 5 to 20   | EI 45 – V – X – F – W 20  | E 120 – V – X – F – W 5 to 20  |
|   | E 120 – V – X – F – W 5 to 20   |                                |

| <b>Fire resistance classification</b><br><b>(horizontal linear joint seals in a stone wall)</b> |   |                                |
|---|---|--------------------------------|
| <b>Bostik FP 403 applied at both faces, connecting stone to wood</b>                            | <b>Bostik FP 403 applied at both faces, connecting stone to steel</b> |                                |
| <b>Wall thickness ≥ 100 mm</b>  | <b>Wall thickness ≥ 100 mm</b>  | <b>Wall thickness ≥ 150 mm</b> |
| EI 120 – T – X – F – W 5 to 20  | EI 45 – T – X – F – W 5 to 20   | EI 90 – T – X – F – W 5 to 20  |
| E 120 – T – X – F – W 5 to 20   | EI 60 – T – X – F – W 20  | EI 120 – T – X – F – W 20      |
| E 240 – T – X – F – W 20  | E 120 – T – X – F – W 5 to 20   | E 120 – T – X – F – W 5 to 20  |


| <b>Fire resistance classification</b><br><b>(vertical and horizontal linear joint seals in a stone wall)</b> |  |
|--|--|
| <b>Fully filled with Bostik FP 403, vertically orientated, connecting stone to steel</b>                     | <b>Fully filled with Bostik FP 403, horizontally orientated, connection stone to steel</b> |
| <b>Wall thickness ≥ 100 mm</b>   | <b>Wall thickness ≥ 100 mm</b>   |
| EI 45 – V – X – F – W 20   | EI 90 – T – X – F – W 20   |
| E 120 – V – X – F – W 20   | E 120 – T – X – F – W 20   |

E = Criterion integrity, I = Criterion insulation, V = Vertical application in a vertical wall, T = Horizontal application in a vertical wall  
 X = No movement applied, F = Splice applied in the field, W = Permitted width range in millimetres (see Graph 1 for seal depth)

The following conditions apply:

- the classifications are valid for linear joint seals in a wall with an orientation as mentioned (vertical or horizontal);
- the linear joint seals may connect to any type of wall of aerated concrete (class G4/600 or heavier), concrete, block work, limestone or masonry. At the other side, the linear joint seals may connect to:
  - any type of wooden construction with a density of  $500 \pm 50 \text{ kg/m}^3$  or higher where the wooden construction is placed over the full thickness of the wall or at least 100 mm, or;
  - any type of steel construction with a melting point above 1000°C and the steel construction is placed over the full thickness of the wall or as mentioned;
- the surfaces of the material on which FP 403 Fireseal Hybrid is applied are thoroughly cleaned and treated with primer when needed;
- except for the fully filled linear joint seals, the use of suitable PE / PU backing material is mandatory;
- except for the fully filled linear joint seals, the required depth of FP 403 Fireseal Hybrid depends on the width of the linear joint seal. The minimum depth of FP 403 Fireseal Hybrid in relation to the width of the linear joint seal is shown in Graph 1. The required depth of the sealant may also be increased with respect to the Graph (the line is the minimum and recommended seal depth);
- the allowed movement capability in practice is maximized to 7.5 %;
- the classifications are valid in both directions.

**Graph 1: Minimum seal depth in relation to the seal width**

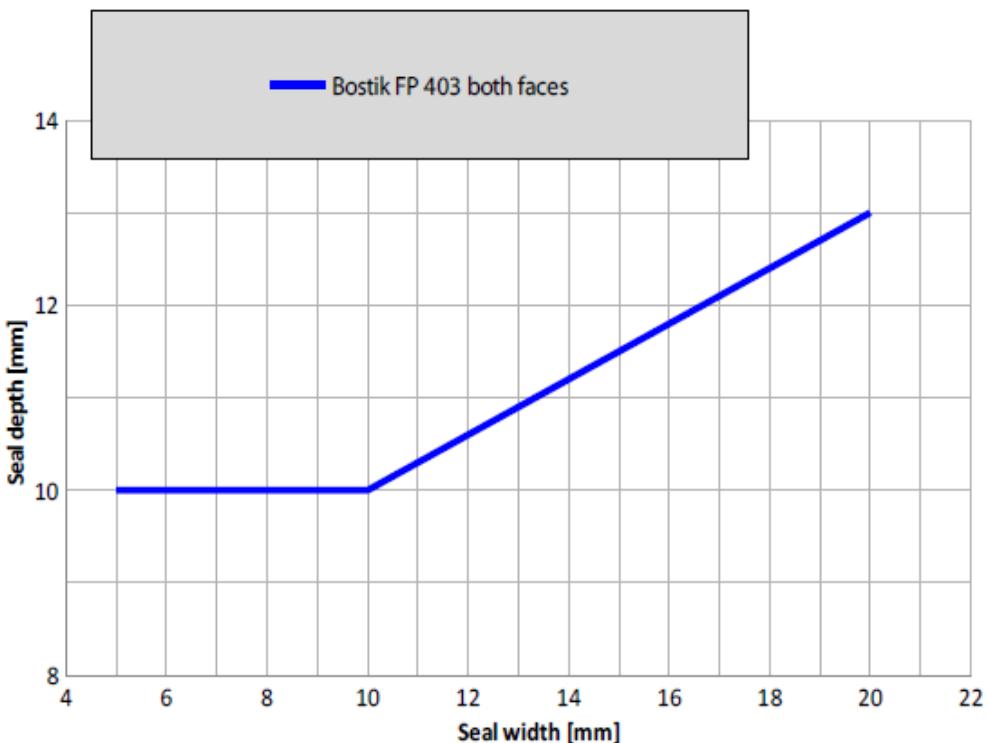

**Classification of the fire resistance *Bostik FP 403 in combination with Bostik FP 404 (PU foam)***
**Fire resistance classification (Bostik FP 403 in combination with Bostik FP 404)**


|   |   |
|---|---|
| <b>Bostik FP 403 applied at the unexposed face,<br/>Bostik FP 404 applied at the exposed face,<br/>vertically orientated connecting stone to wood</b> | <b>Bostik FP 403 applied at the unexposed face, Bostik<br/>FP 404 applied at the exposed face, horizontally<br/>orientated connecting stone to wood</b> |
| <b>Wall thickness ≥ 100 mm</b>  | <b>Wall thickness ≥ 100 mm</b>  |
| EI 120 – V – X – F – W 8 to 20<br><br>E 120 – V – X – F – W 8 to 20   | EI 120 – T – X – F – W 8 to 20<br><br>E 120 – T – X – F – W 8 to 20   |

E = Criterion integrity, I = Criterion insulation, V = Vertical application in a vertical wall, T = Horizontal application in a vertical wall  
 X = No movement applied, F = Splice applied in the field, W = Permitted width range in millimetres (see Graph 2 for seal depth)

The following conditions apply:

- the classifications are valid for linear joint seals in a wall with an orientation as mentioned (vertical or horizontal);
- the linear joint seals may connect to any type of wall of aerated concrete (class G4/600 or heavier), concrete, block work, limestone or masonry. At the other side, the linear joint seals may connect to any type of wooden construction with a density of  $500 \pm 50 \text{ kg/m}^3$  or more and the wooden construction is placed over the full thickness of the wall or at least 100 mm;
- the surfaces of the material on which FP 403 Fireseal Hybrid and Bostik FP 404 Fire Retardant PU (Gun)Foam is applied are thoroughly cleaned and treated with primer and moistened with water when needed;
- the required depth of FP 403 Fireseal Hybrid depends on the width of the linear joint seal. The minimum depth of FP 403 Fireseal Hybrid in relation to the width of the linear joint seal is shown in Graph 2 below. The required depth of the sealant may also be increased with respect to the Graph (the line is the minimum and recommended seal depth). The rest of the slot is fully filled with Bostik FP 404 Fire Retardant PU (Gun)Foam;
- the allowed movement capability in practice is maximized to 7.5 %;
- the classifications are valid for FP 403 Fireseal Hybrid applied at the unexposed face.

**Graph 2: Minimum seal depth in relation to the seal width**

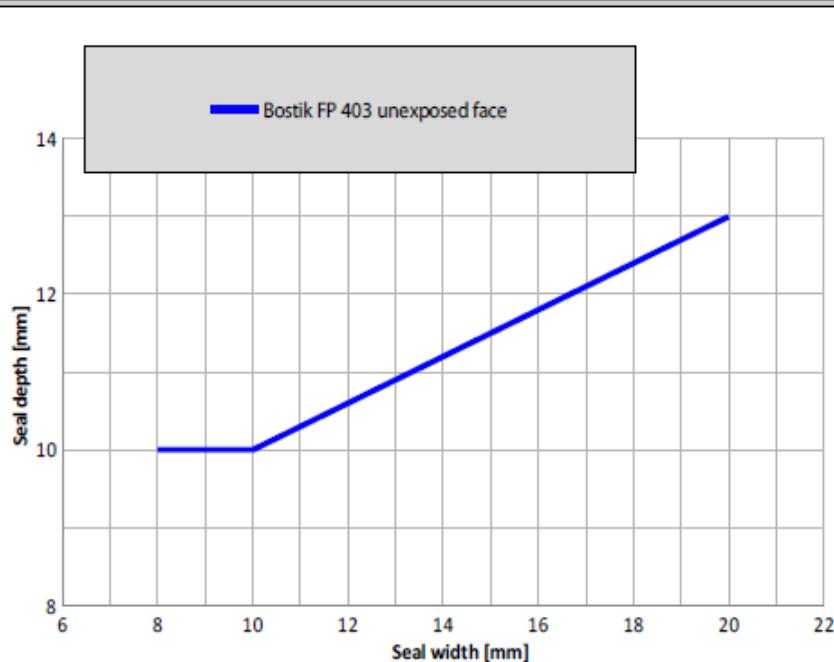


| <b>Fire resistance classification</b><br><b>(vertical linear joint seals in a gypsum and / or stone wall)</b> |   |   |   |
|---|---|---|---|
| <b>Bostik FP 403 connecting gypsum to stone,<br/>applied at both faces</b>                                    |   | <b>Bostik FP 403 connecting gypsum to gypsum,<br/>applied at both faces</b>               |   |
| <b>Wall thickness <math>\geq 75</math> mm</b><br>See figure 1<br>EI 60 – V – X – F – W 10                     | <b>Wall thickness <math>\geq 100</math> mm</b><br>See figure 2<br>EI 120 – V – X – F – W 10 | <b>Wall thickness <math>\geq 75</math> mm</b><br>See figure 3<br>EI 60 – V – X – F – W 10 | <b>Wall thickness <math>\geq 100</math> mm</b><br>See figure 4<br>EI 120 – V – X – F – W 10 |

E = Criterion integrity, I = Criterion insulation, V = Vertical application in a vertical wall, X = No movement applied, F = Splice applied in the field, W = Permitted width range in millimetres (depth see conditions)

The following conditions apply:

- the classifications are valid for linear joint seals in a wall with an orientation as mentioned (vertical);
- the linear joint seals may connect to any type of wall of aerated concrete (class G4/600 or heavier), concrete, block work, limestone or masonry with a minimal thickness as mentioned (75 or 100 mm);
- the linear joint seals may connect to a gypsum wall with a minimum thickness as mentioned (75 or 100 mm). In practice, the metal profiles of the gypsum panel are mechanically fixed at a distance every 300 mm or less. Mechanically fixation of the metal profiles is mandatory;
- the classifications are only valid for constructions shown in figures 1 to 4;
- the surfaces of the material on which the sealant is applied are thoroughly cleaned and treated with primer when needed;
- the depth of FP 403 Fireseal Hybrid in a wall of 75 mm is 12.5 mm at both faces, representing the full thickness of the gypsum panel, see figures 1 and 3. The depth of FP 403 Fireseal Hybrid in a wall of 100 mm is 15 mm at both faces. The rest of the cavity behind the sealant is filled up with suitable PE / PU backing material, see figures 2 and 4;
- the allowed movement capability in practice is maximized to 7.5 %;
- the classifications are valid for both directions.






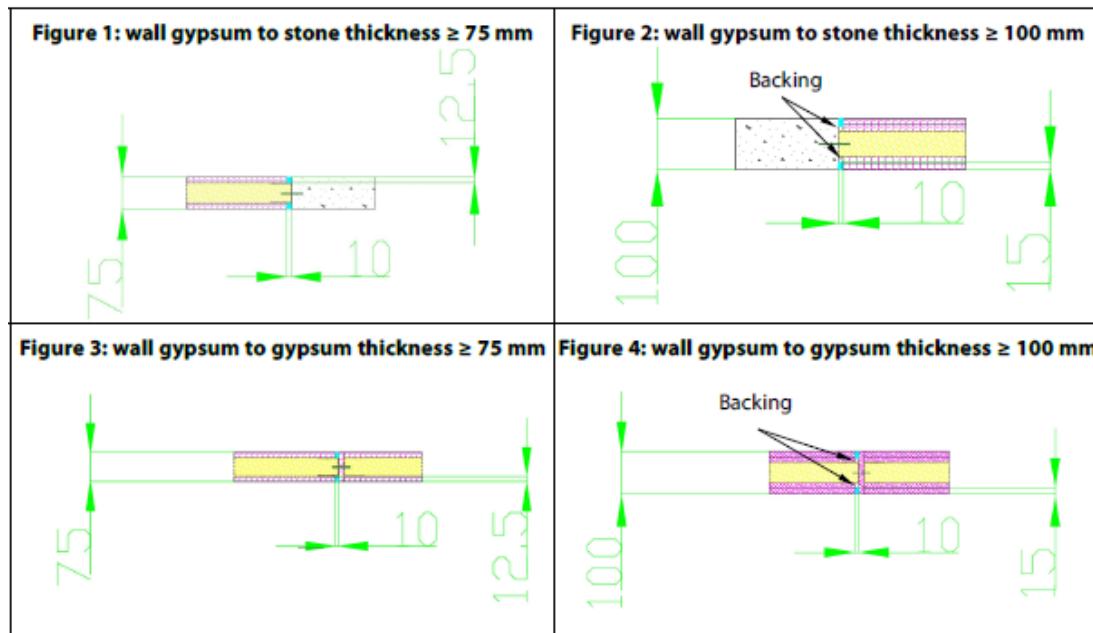


| <b>Fire resistance classification</b><br><b>(horizontal linear joint seals in a gypsum and stone wall and a gypsum wall abutting a floor)</b> |   |   |  |
|---|---|---|--|
| <b>Bostik FP 403 wall thickness <math>\geq</math> 75 mm</b>   |   | <b>Bostik FP 403 wall thickness <math>\geq</math> 100 mm</b>                                    |  |
| Applied at the unexposed face, see figure 5<br>EI 60 – T – M 25 <sup>1</sup> – F – W 10   | Applied at both faces, see figure 6<br>EI 60 – T – M 25 <sup>1</sup> – F – W 10 | Applied at the unexposed face, see figures 7 and 9<br>EI 120 – T – M 25 <sup>1</sup> – F – W 10 | Applied at both faces, see figures 8 and 10<br>EI 120 – T – M 25 <sup>1</sup> – F – W 10 |





E = Criterion integrity, I = Criterion insulation, T = Horizontal application in a vertical wall and wall abutting a floor, M 25 = Movement induced 25 %, F = Splice applied in the field, W = Permitted width range in millimetres (depth see conditions)

The following conditions apply:

- the classifications are valid for linear joint seals in a wall and a wall abutting a floor, ceiling or roof with an orientation as mentioned (horizontal);
- the linear joint seals may connect to any type of construction of aerated concrete (class G4/600 or heavier), concrete, block work or masonry with a minimal thickness as mentioned (75 or 100 mm);
- the linear joint seals may connect to a gypsum wall with a minimum thickness as mentioned. In practice, the metal profiles of the gypsum wall are mechanically fixed at a distance every 300 mm or less. Mechanically fixation of the metal profiles is mandatory;
- the classifications are only valid for constructions shown in figures 5 to 10;
- the surfaces of the material on which the sealant is applied are thoroughly cleaned and treated with primer when needed;
- the depth of FP 403 Fireseal Hybrid in a wall of 75 mm is 12.5 mm at both faces or at the unexposed face, representing the full thickness of the gypsum panel, see figures 5 and 6;
- the depth of FP 403 Fireseal Hybrid in a wall of 100 mm is 12.5 mm at both faces or at the unexposed face, representing the full thickness of the gypsum panel, see figures 9 and 10;
- the depth of FP 403 Fireseal Hybrid in a wall of 100 mm is 15 mm at both faces or at the unexposed face. The rest of the cavity behind the sealant is completely filled up with suitable PE / PU backing material, see figures 7 to 8;
- the allowed movement capability of the linear joint seals in practice is maximized to 25 %;
- when FP 403 Fireseal Hybrid is applied at both faces, the classifications are valid for both directions. When FP 403 Fireseal Hybrid is applied at one face, the classifications are valid with FP 403 Fireseal Hybrid at the unexposed face.
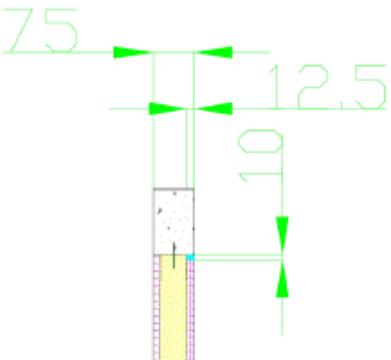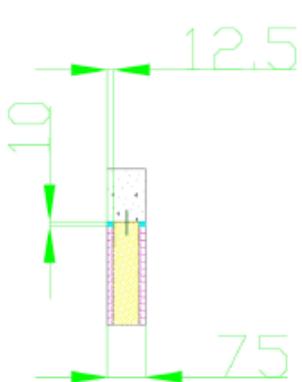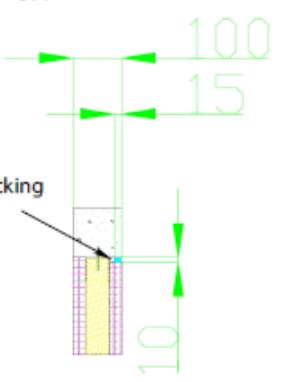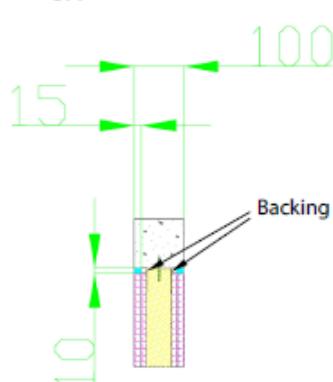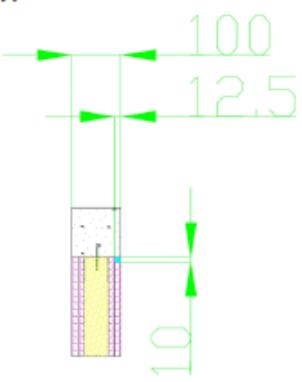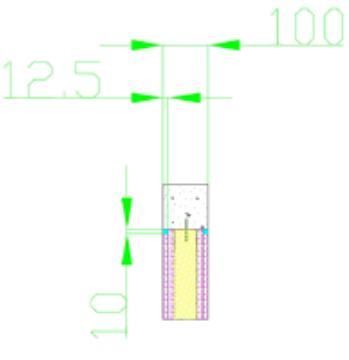
|  |  |
|--|--|
| <b>Figure 5: wall gypsum to stone thickness <math>\geq 75</math> mm</b><br> <p>Diagram showing a wall section with a thickness of 75 mm. The top layer is 12.5 mm thick, and the bottom layer is 10 mm thick. A vertical line with arrows at the top and bottom indicates a total thickness of 75 mm. The middle section is labeled 'Backing'.</p>      | <b>Figure 6: wall gypsum to stone thickness <math>\geq 75</math> mm</b><br> <p>Diagram showing a wall section with a thickness of 75 mm. The top layer is 12.5 mm thick, and the bottom layer is 10 mm thick. A vertical line with arrows at the top and bottom indicates a total thickness of 75 mm. The middle section is labeled 'Backing'.</p>       |
| <b>Figure 7: wall gypsum to stone thickness <math>\geq 100</math> mm</b><br> <p>Diagram showing a wall section with a thickness of 100 mm. The top layer is 15 mm thick, and the bottom layer is 10 mm thick. A vertical line with arrows at the top and bottom indicates a total thickness of 100 mm. The middle section is labeled 'Backing'.</p>     | <b>Figure 8: wall gypsum to stone thickness <math>\geq 100</math> mm</b><br> <p>Diagram showing a wall section with a thickness of 100 mm. The top layer is 15 mm thick, and the bottom layer is 10 mm thick. A vertical line with arrows at the top and bottom indicates a total thickness of 100 mm. The middle section is labeled 'Backing'.</p>      |
| <b>Figure 9: wall gypsum to stone thickness <math>\geq 100</math> mm</b><br> <p>Diagram showing a wall section with a thickness of 100 mm. The top layer is 12.5 mm thick, and the bottom layer is 10 mm thick. A vertical line with arrows at the top and bottom indicates a total thickness of 100 mm. The middle section is labeled 'Backing'.</p> | <b>Figure 10: wall gypsum to stone thickness <math>\geq 100</math> mm</b><br> <p>Diagram showing a wall section with a thickness of 100 mm. The top layer is 12.5 mm thick, and the bottom layer is 10 mm thick. A vertical line with arrows at the top and bottom indicates a total thickness of 100 mm. The middle section is labeled 'Backing'.</p> |

**Annex B – Airborne sound insulation**
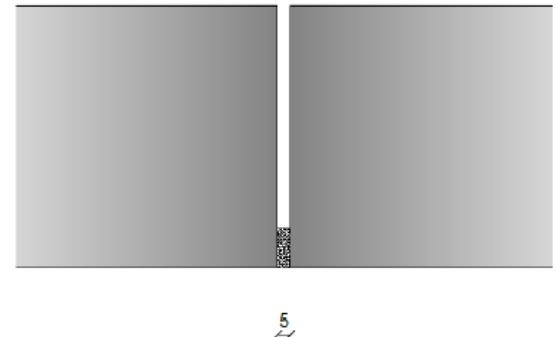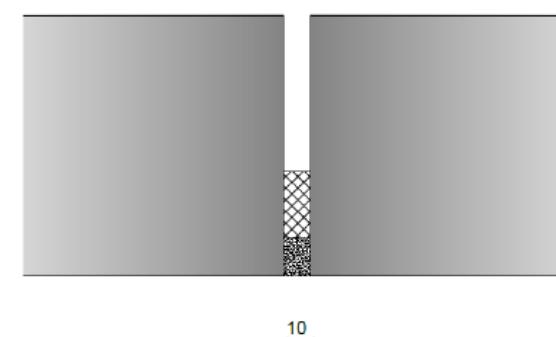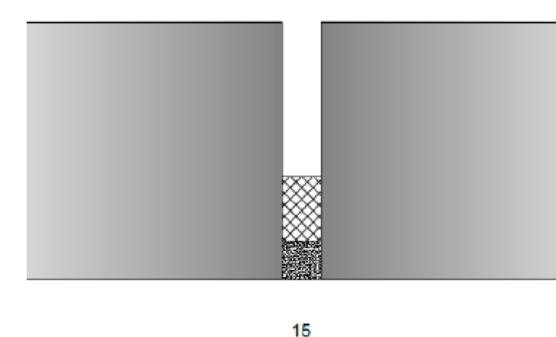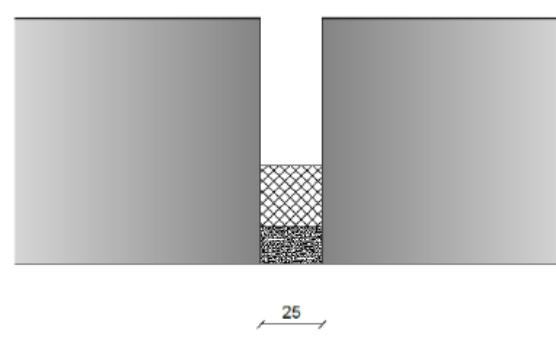
|                     |  |
|---------------------|--|
| Joint Width = 5 mm  | <br>5    |
| Joint Width = 10 mm | <br>10   |
| Joint Width = 15 mm | <br>15 |
| Joint Width = 25 mm | <br>25 |

The Bostik FP 403 Fireseal Hybrid sealant, 10 mm depth is backed with PE / PU backer rod.

|                                | Joint width  |              |              |              |
|--------------------------------|--------------|--------------|--------------|--------------|
|                                | 5 mm         | 10 mm        | 15 mm        | 25 mm        |
| $R_{s,w}(C;C_{tr})$            | 51(-1;-3) dB | 53(-1;-4) dB | 51(-1;-3) dB | 52(-1;-4) dB |
| $C_{100-5000};C_{tr;100-5000}$ | (0;-3) dB    | (0;-4) dB    | (0;-3) dB    | (0;-4) dB    |
| $C_{50-3150};C_{tr;50-3150}$   | (-1;-6) dB   | (-2;-8) dB   | (-1;-6) dB   | (-1;-7) dB   |
| $C_{50-5000};C_{tr;50-5000}$   | (0;-6) dB    | (-1;-8) dB   | (0;-6) dB    | (0;-7) dB    |
| $D_{n,e,w}$                    | 60 dB        | 60 dB        | 58 dB        | 59 dB        |
| $R_w$                          | 30 dB        | 33 dB        | 33 dB        | 36 dB        |

