

## European Technical Assessment

**ETA-04/0076  
of 01/07/2018**

*(English language translation, the original version is in French language)*

### General Part

Nom commercial  
*Trade name*

**SPIT ISO**

Famille de produit  
*Product family*

**Cheville à clou pour fixation de système composite d'isolation  
thermique extérieure dans le béton et la maçonnerie**  
***Nailed-in anchor for fixing of external insulation composite  
systems with rendering in concrete and masonry***

Titulaire  
*Manufacturer*

SPIT SAS  
route de Lyon  
F-26500 BOURG-LES-VALENCE  
France

Usine de fabrication  
*Manufacturing plants*

SORMAT plant 1 Société SPIT  
Route de Lyon  
F-26501 BOURG-Les-VALENCE

Cette évaluation contient:  
*This assessment contains*

13 pages incluant 10 annexes qui font partie intégrante de cette  
évaluation  
***13 pages including 10 annexes which form an integral part of this  
assessment***

Base de l'ETE  
*Basis of ETA*

EAD 330196-00-0604, édition juin 2016  
***EAD 330196-00-0604, edition June 2016***

Cette évaluation remplace:  
*This assessment replaces*

ATE-04/0076 valide du 28/06/2013  
ETA-04/0076 with validity from 28/06/2013

*Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such. Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may be made, with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.*

## Specific Part

### 1 Technical description of the product

The SPIT ISO anchor consists of a plastic expansion sleeve with a plate for fixing the thermal insulation and a plastic nail as an expansion element. The anchor sleeve is made of polypropylene and the nail is made of polypropylene or polyamide 6 depending on the anchor sizes. The plate exists in three different diameters depending on the insulation system to be fixed (Ø50 mm in case of thickness of insulation  $\leq 80$  mm, Ø60 mm in case of thickness of insulation  $\geq 95$  mm and 90 mm in case of rock wool insulation). The plastic sleeve is expanded by hammering in the expansion element which presses the sleeve against the wall of the drilled hole. An additional plastic plate  $\phi 90$ mm can be used in conjunction with anchors having a plastic plate  $\phi 60$ mm (inserted between the fixture and the anchor).

The installed anchor is shown in Annex A.

### 2 Specification of the intended use

The anchor is to be used as multiple fixing for the anchorage of profiles for external thermal insulation composite system (ETICS) in concrete and masonry.

The performances given in Annex C are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The provisions made in this European Technical Assessment are based on an assumed working life of the anchor of 25 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the products in relation to the expected economically reasonable working life of the works.

### 3 Performance of the product

#### 3.1 Mechanical resistance and stability (BWR 1)

For Basic Requirement Mechanical Resistance and Stability (BWR1) the same criteria are valid as for Basic Requirement Safety in use.

#### 3.2 Sécurité en cas d'incendie (BWR 2)

Not relevant.

#### 3.3 Hygiene, health and environment (BWR 3)

Regarding dangerous substances contained in this European Technical Assessment, there may be requirements applicable to the products falling within its scope (e.g. transported European legislation and national laws, regulations and administrative provisions). In order to meet provisions of the regulation (EU) No 305/2011, these requirements need also to be complied with, when they apply.

#### 3.4 Safety in use(BWR 4)

Essential characteristic	Performance
Characteristic resistances in concrete and masonry	See Annex C1
Displacements	See Annex C1
Installation distances and dimensions of members	See Annex C1

**3.5 Protection against noise (BWR 5)**

Not relevant.

**3.6 Energy economy and heat retention (BWR 6)**

Essential characteristic	Performance
Coefficient thermal transmittance	Voir Annexe C2

**3.7 Sustainable use of natural resources (BWR 7)**

For the sustainable use of natural resources no performance was determined for this product.

**3.8 General aspects relating to fitness for use**

Durability and Serviceability are only ensured if the specifications of intended use according to Annex B1 are kept.

**4 Assessment and verification of constancy of performance (EVCP)**

According to the Decision 97/463/EC of the European Commission , as amended, the system of assessment and verification of constancy of performance (see Annex V to Regulation (EU) No 305/2011) given in the following table apply.

Product	Intended Use	Level or Class	Systeme
Nailed-in plastic anchor for fixing of external thermal insulation composite systems	Nailed-in plastic anchor for fixing of external thermal insulation composite systems with rendering on concrete and masonry	—	1

**5 Technical details necessary for the implementation of the AVCP system**


Technical details necessary for the implementation of the Assessment and verification of constancy of performance (AVCP) system are laid down in the control plan deposited at Centre Scientifique et Technique du Bâtiment.

The manufacturer shall, on the basis of a contract, involve a notified body approved in the field of anchors for issuing the certificate of conformity CE based on the control plan.

Issued in Marne La Vallée le **01/07/2018** par  
Charles Baloche  
Directeur technique

*The original French version is signed*

Schema of the SPIT ISO anchor in use

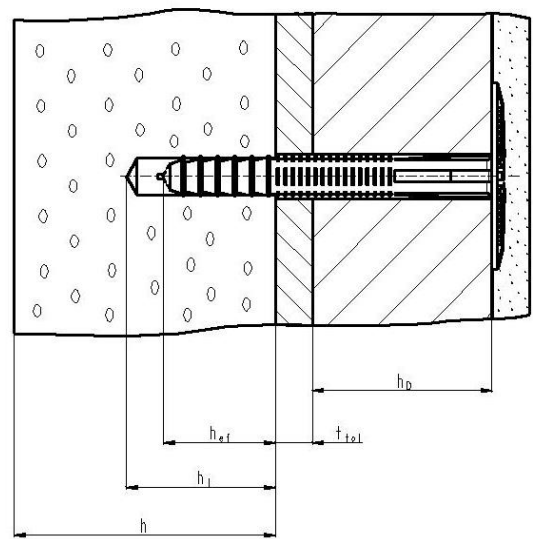

**Intended use** : anchorage of ETICS in concrete and masonry.




- $h_D$  : thickness of the insulation
- $h_{ef}$  : effective anchorage depth
- $h$  : thickness of base material
- $h_1$  : depth of drilled hole
- $t_{tol}$  : thickness of equalizing layer or non-load bearing coating

SPIT ISO	Annex A1
Description of the product Installed anchor	

### ISO plate 90 mm :

ISO 10-40/60





ISO 10-70/80

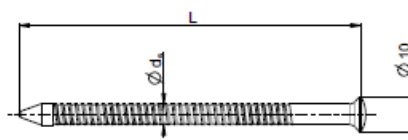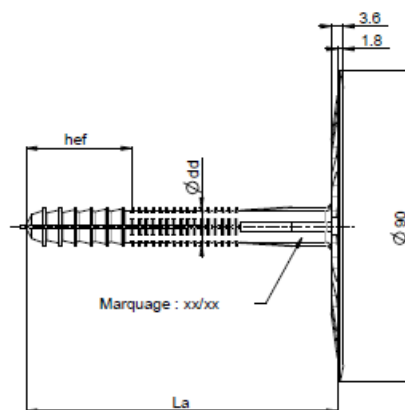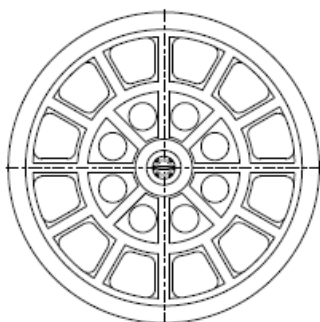

### ISO plate 50 mm :

ISO 10-40/60

ISO 10-70/80

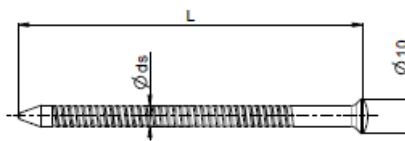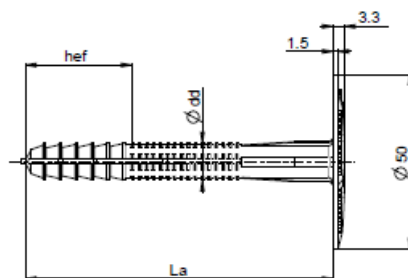

SPIT ISO

Description of the product


Different components of the anchor : sleeve and nails

Annex A2

### ISO plate 60 mm :


ISO 10-45/65  
ISO 10-75/85  
ISO 10-95/105

ISO 10-115/125  
ISO 10-135/145  
ISO 10-155/165

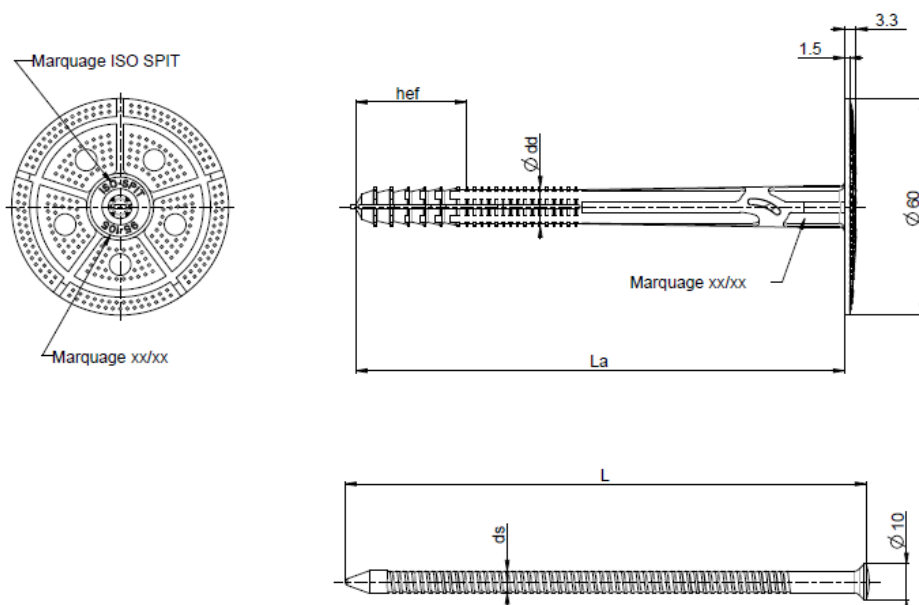

### ISO plate Ø60 mm :

ISO 10-175/185  
ISO 10-195/205

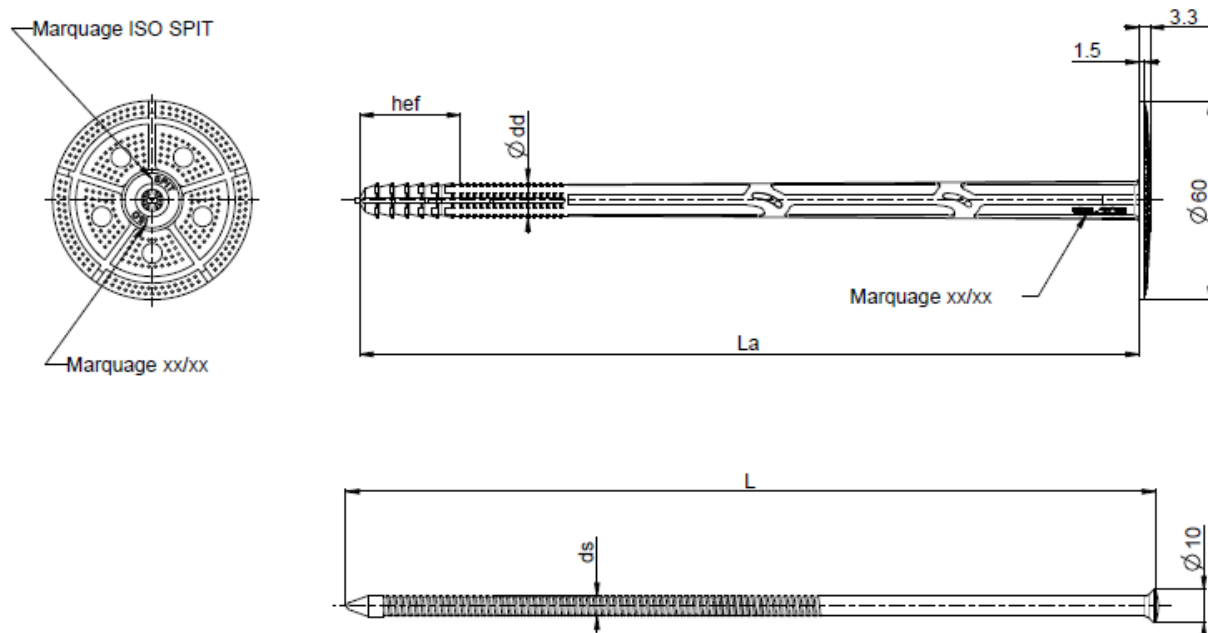


SPIT ISO

Description of the product

Different components of the anchor : sleeve and nails

Annex A3

**Plate Ø90 :**

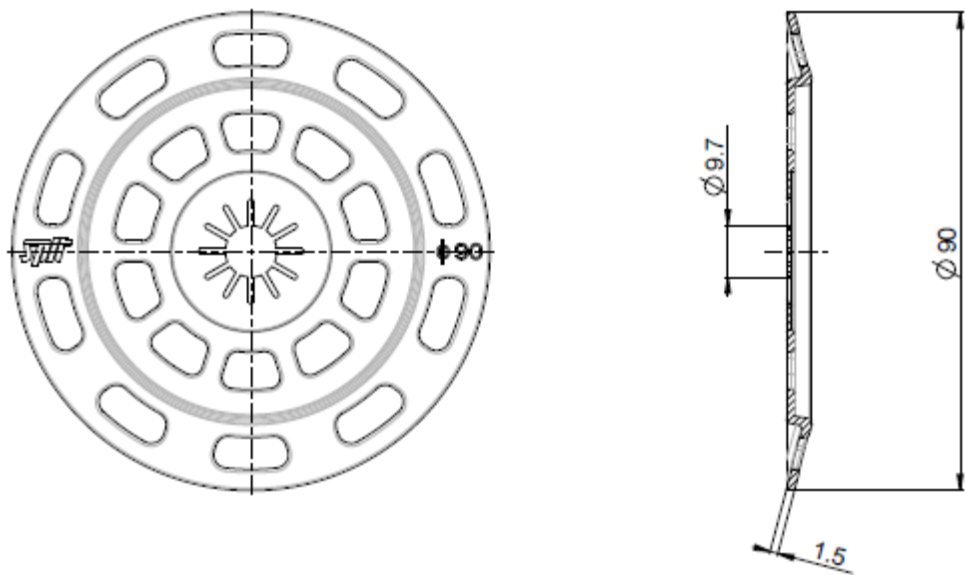

SPIT ISO	Annex A4
<b>Description of the product</b> Different components of the anchor : sleeve and nails	

**Table A1 : Materials**

Designation	Material	
	Nail	Plastic expansion sleeve
ISO 10 - 10/30	Polypropylene (white shade)	Polypropylene
ISO 10 - 40/60	Glass Fiber reinforced Polyamide (orange shade)	
ISO 10 - 45/65		
ISO 10 - 70/80		
ISO 10 - 75/85		
ISO 10 - 95/105		
ISO 10 - 115/125		
ISO 10 - 135/145		
ISO 10 - 155/165		
ISO 10 - 175/185		
ISO 10 - 195/205		

**Table A2 : Dimensions of components**

Anchor type	Diameter of the expansion sleeve $d_d$	Length of the expansion sleeve $L_d$	Length of the anchor $L_d + 3$	Diameter of the plate -	Diameter of the nail $d_s$	Length of the nail $L$
	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]
ISO 10 - 10/30	10	60	63	50	6	63
ISO 10 - 40/60		90	93	50		100
				90		
ISO 10 - 45/65		95	98	60		105
ISO 10 - 70/80		110	113	50		120
				90		
ISO 10 - 75/85		115	118	90		125
ISO 10 – 95/105		135	138	60		145
ISO 10 - 115/125		155	158	60		165
ISO 10 - 135/145		175	178			185
ISO 10 - 155/165		195	198			205
ISO 10 - 175/185		215	218			225
ISO 10 - 195/205	235	238	245			

**SPIT ISO**

**Description of the product**  
Dimensions, Material

**Annex A5**



**Table A3 : Installation data**

Anchor type	Thickness of the insulation mini/maxi	Length of the expansion sleeve	Drill hole diameter	Depth of the drilled hole	Embedment depth
	$h_D$ [mm]	$L_a$ [mm]	$d_0$ [mm]	$h_0$ [mm]	$h_{ef}$ [mm]
<b>ISO 10 - 10/30</b>	10/30	60	10	50	30
<b>ISO 10 - 40/60</b>	40/60	90			
<b>ISO 10 - 45/65</b>	45/65	95			
<b>ISO 10 - 70/80</b>	70/80	110			
<b>ISO 10 - 75/85</b>	75/85	115			
<b>ISO 10 - 95/105</b>	95/105	135			
<b>ISO 10 - 115/125</b>	115/125	155			
<b>ISO 10 - 135/145</b>	135/145	175			
<b>ISO 10 - 155/165</b>	155/165	195			
<b>ISO 10 - 175/185</b>	175/185	215			
<b>ISO 10 - 195/205</b>	195/205	235			

**Determination of the maximum thickness of insulation with SPIT ISO:**

$$h_D = L_a - t_{tol} - h_{ef}$$

$h_D$  : thickness of the insulation

$L_a$  : Length of the expansion sleeve

$t_{tol}$  : thickness of equalizing layer or non-load bearing coating

$h_{ef}$  : effective anchorage depth

As example, for the SPIT **ISO 10-115/125** :

$$L_a = 155 \text{ mm}$$

$$t_{tol} = 5 \text{ mm}$$

$$h_{ef} = 30 \text{ mm}$$

$$h_D = 155 - 5 - 30$$

$$h_{D \text{ max}} = 120 \text{ mm thickness of the insulation}$$

**SPIT ISO**

**Description of the product**  
Installation data

**Annex A6**

## Specifications of intended use

### Anchorage subject to:

- The anchor shall only be used for the transmission of wind suction loads. All other loads such as dead load and restraints shall be transmitted by the adhesion of the relevant external thermal insulation composite system.

### Base materials:

- Use category « A » : Reinforced or unreinforced normal weight concrete, with strength class  $\geq C12/15$ , according to EN 206 according annex B2;
- Use category « B » : solid masonry according to Annex B2 ;
- For other base materials of the use categories « A », or « B », the characteristic resistance of the anchor may be determined by job site tests according to TR 051, Edition December 2016 (EOTA).

### Design:

- The design of anchorages is carried out in compliance with EAD 330196-00-0604 (June 2016), "Plastic anchors for fixing of external thermal insulation composite systems with rendering" under the responsibility of an engineer experienced in anchorages. In the absence of national regulations, the partial safety factors  $\gamma_M=2.2$  and  $\gamma_M=1.5$  must be taken into account.
- Verifiable calculation notes and drawings shall be prepared taking account of the loads to be anchored, the nature and strength of the base materials, the thickness of insulation and the dimensions of the anchorage as well as of the relevant tolerances.
- Proof of direct local application of load on the base material shall be delivered.
- The anchor with the bi-chromated steel nail shall be used with a thermal insulation cover of at least 50mm

### Installation:





- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters on the site.
- Use of the anchor only as supplied by the manufacturer without exchanging the components of an anchor.
- Anchor installation in accordance with the manufacturer's specifications and drawings prepared for that purpose and using the appropriate tools.
- Checks before placing the anchor to ensure that the characteristic values of the base material in which the anchor is to be placed are identical to the values to which the characteristic loads apply.
- Observation of the drilling method : in the case of horizontally perforated clay bricks, the drilled hole is carried out using a rotary drill. In the case of other base materials covered in this Assessment, the drilled hole is carried out using hammer or impact drilling.
- Placing drill holes without damaging the reinforcement.
- Temperature during installation of the anchor  $\geq 0^{\circ}\text{C}$ .
- Exposure to UV due to solar radiation of the anchor not protected by rendering 6 weeks.

**SPIT ISO**

**Intended Use**  
Specifications

**Annexe B1**

**Table B1 : Base materials**

Base material	Dimensions L x l x H [mm]		References	Compressive strength [MPa]
Concrete C15/20	[EN 206]		EN 206	[EN 206]
Concrete C50/60	[EN 206]		EN 206	[EN 206]
Clay brick		220x110x 55	NF EN 771-1	4.7 (bending test)
Aggregates concrete solid masonry units		500x150x200	NF EN 771-3	12.5
Horizontally perforated clay bricks		500x200x200	NF EN 771-1	5.9
Aggregates concrete hollow masonry units		500x200x200	NF EN 771-3	8.2

**SPIT ISO**

**Installation data (concrete and masonry)**  
Base materials

**Annex B2**

**Table C1 : Characteristic resistance to tension loads  $N_{Rk}$  in concrete and masonry for a single anchor in daN**

Base material	Characteristic resistance to tension loads $N_{Rk}$ in daN	
	SPIT ISO with polypropylene nail	SPIT ISO with PA6 bonded fibreglass nail
Concrete C15/20	20	60
Concrete C20/25 to C50/60	30	75
Clay brick	30	75
Horizontally perforated clay bricks	10	40
Aggregates concrete solid masonry units	30	60
Aggregates concrete hollow masonry units	15	30

**Table C2 : Minimum spacing and edge distances, dimension of members**

Minimum spacing	$S_{min} \geq 100 \text{ mm}$
Minimum edge distance	$C_{min} \geq 100 \text{ mm}$
Minimum thickness of member	$h \geq 100 \text{ mm}$

**Table C3 : Displacements behavior for Spit ISO**

Base Material	for a tensile load N	Displacements $\delta$
	[daN]	[mm]
Concrete C15/20 (EN 206)	60.0	0.2
Concrete C20/25 to C50/60 (EN 206)	75.0	0.2
Clay bricks (NF EN 771-1)	75.0	0.3
Horizontally perforated clay bricks (NF EN 771-1)	40.0	0.1
Aggregates concrete solid masonry units (NF EN 771-3)	60.0	0.2
Aggregates concrete hollow masonry units (NF EN 771-3)	30.0	0.3

**SPIT ISO**

**Characteristic resistance in concrete and masonry  
Minimum spacing and edge distances and displacements**

**Annex C1**

**Table C4 : Point thermal transmittance**

The point thermal transmittance (CHI-value) of the anchor according EOTA Technical Report TR 025 "Determination of point thermal transmittance of plastic anchors for the anchorage of external thermal insulation composite systems (ETICS)" is given in the following table for use category A, B and C respectively.

Anchor Type	Insulation thickness, $h_D$	Point thermal transmittance, $\chi$
	[mm]	[W/K]
ISO 10	From 30 to < 150	0.001
	From $\geq 150$ to 200	0.000

**Table C5 : Plate stiffness**

The plate stiffness of the anchor according EOTA Technical Report TR 026 "Evaluation of plate stiffness from plastic anchors for fixing of external thermal insulation composite systems with rendering (ETICS)" is given in the following table.

Anchor Type	Diameter of the anchor plate	Load resistance of the anchor plate	Plate stiffness
	[mm]	[kN]	[kN/mm]
ISO 10	50	1.0	0.3
	60	1.0	0.5
	60 + plate $\phi 90$	1.10	0.5
	90	1.08	0.3

**SPIT ISO**

**Description of the product**  
Coefficient thermal transmittance

**Annex C2**